

evacuation diagram

version 1

LEGEND

-  path to exit
-  path to assembly area
-  assembly area
WARNING Keep a minimum 30m clear of the building
-  illuminated exit sign
-  required illuminated exit sign
-  fire extinguisher
-  fire blanket
-  fire hose reel
-  fire indicator panel / main emergency control panel
-  fire hydrant
-  first aid
-  break glass alarm



EMERGENCY

R REMOVE OCCUPANTS FROM IMMEDIATE DANGER AREA
Safety to self, scene and survivors in that order

A ALERT ALL OCCUPANTS AND RAISE AN ALARM
DIAL 000 - Ask for the Fire Brigade

C CONFINE THE DANGER CLOSE DOORS + WINDOWS
Restrict the spread of fire, attempt to extinguish the fire if trained and safe to do so.

E EVACUATE TO A SAFE AREA AND WAIT FOR ASSISTANCE
Use the nearest safe exit door. Once safe wait for assistance from the responding emergency services.

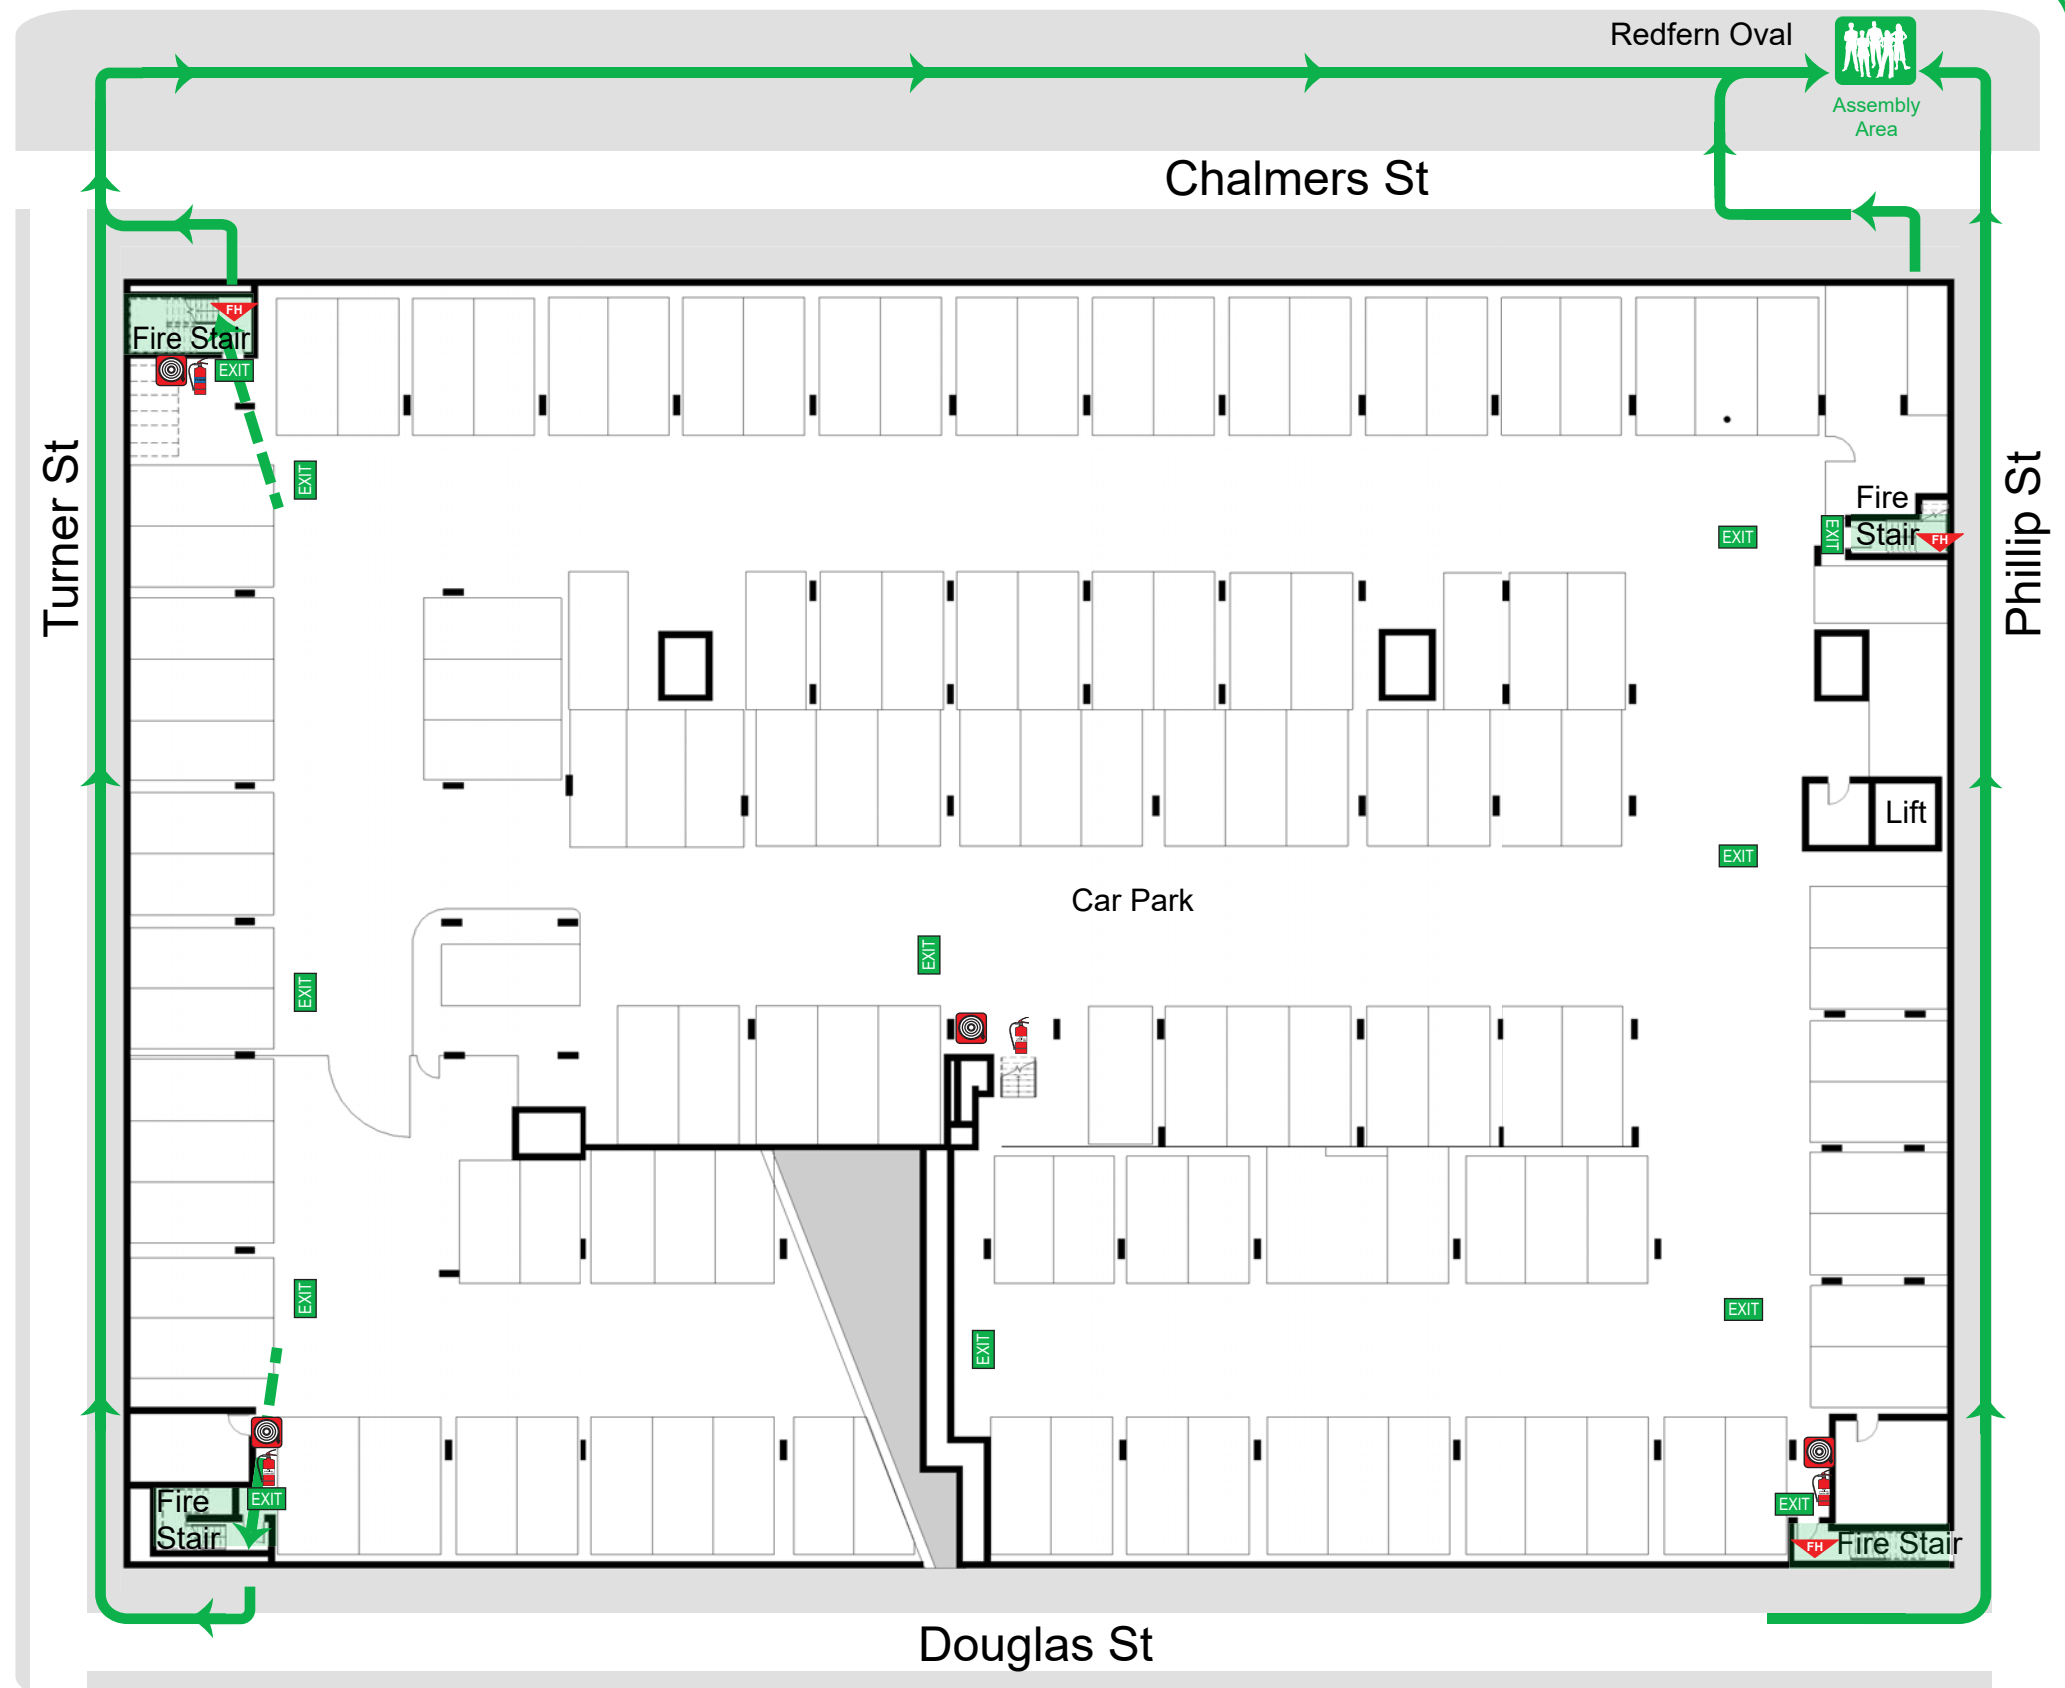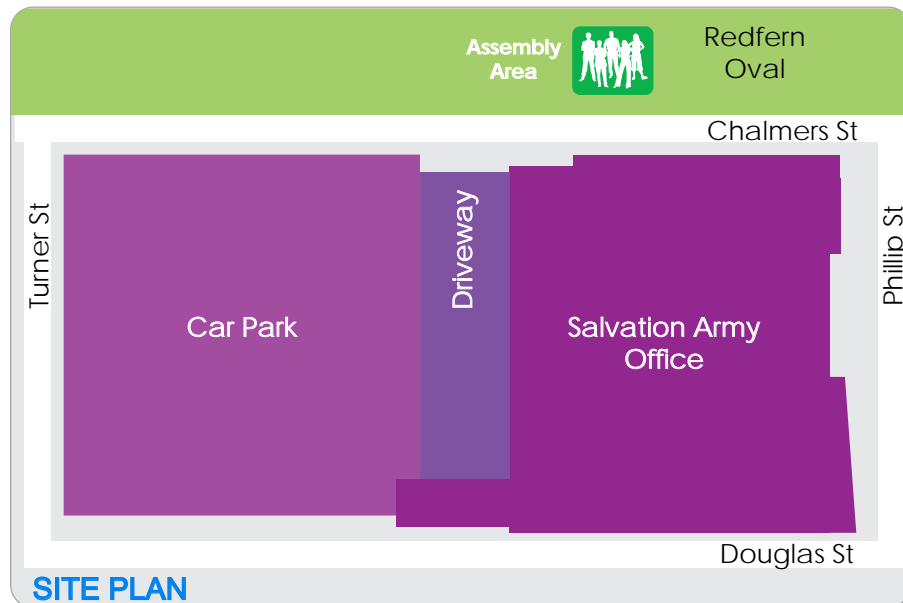

car park - basement

not to scale



tyrrells.com
PLANS & APPROVALS
ph 1300 131 270
© tyrrells.com 2009

evacuation diagram



version 1

LEGEND

-  path to exit
-  path to assembly area
-  assembly area
WARNING Keep a minimum 30m clear of the building
-  illuminated exit sign
-  required illuminated exit sign
-  fire extinguisher
-  fire blanket
-  fire hose reel
-  fire indicator panel / main emergency control panel
-  fire hydrant
-  first aid
-  break glass alarm

EMERGENCY

- R REMOVE OCCUPANTS FROM IMMEDIATE DANGER AREA**
Safety to self, scene and survivors in that order
- A ALERT ALL OCCUPANTS AND RAISE AN ALARM**
DIAL 000 - Ask for the Fire Brigade
- C CONFINE THE DANGER CLOSE DOORS + WINDOWS**
Restrict the spread of fire, attempt to extinguish the fire if trained and safe to do so.
- E EVACUATE TO A SAFE AREA AND WAIT FOR ASSISTANCE**
Use the nearest safe exit door. Once safe wait for assistance from the responding emergency services.

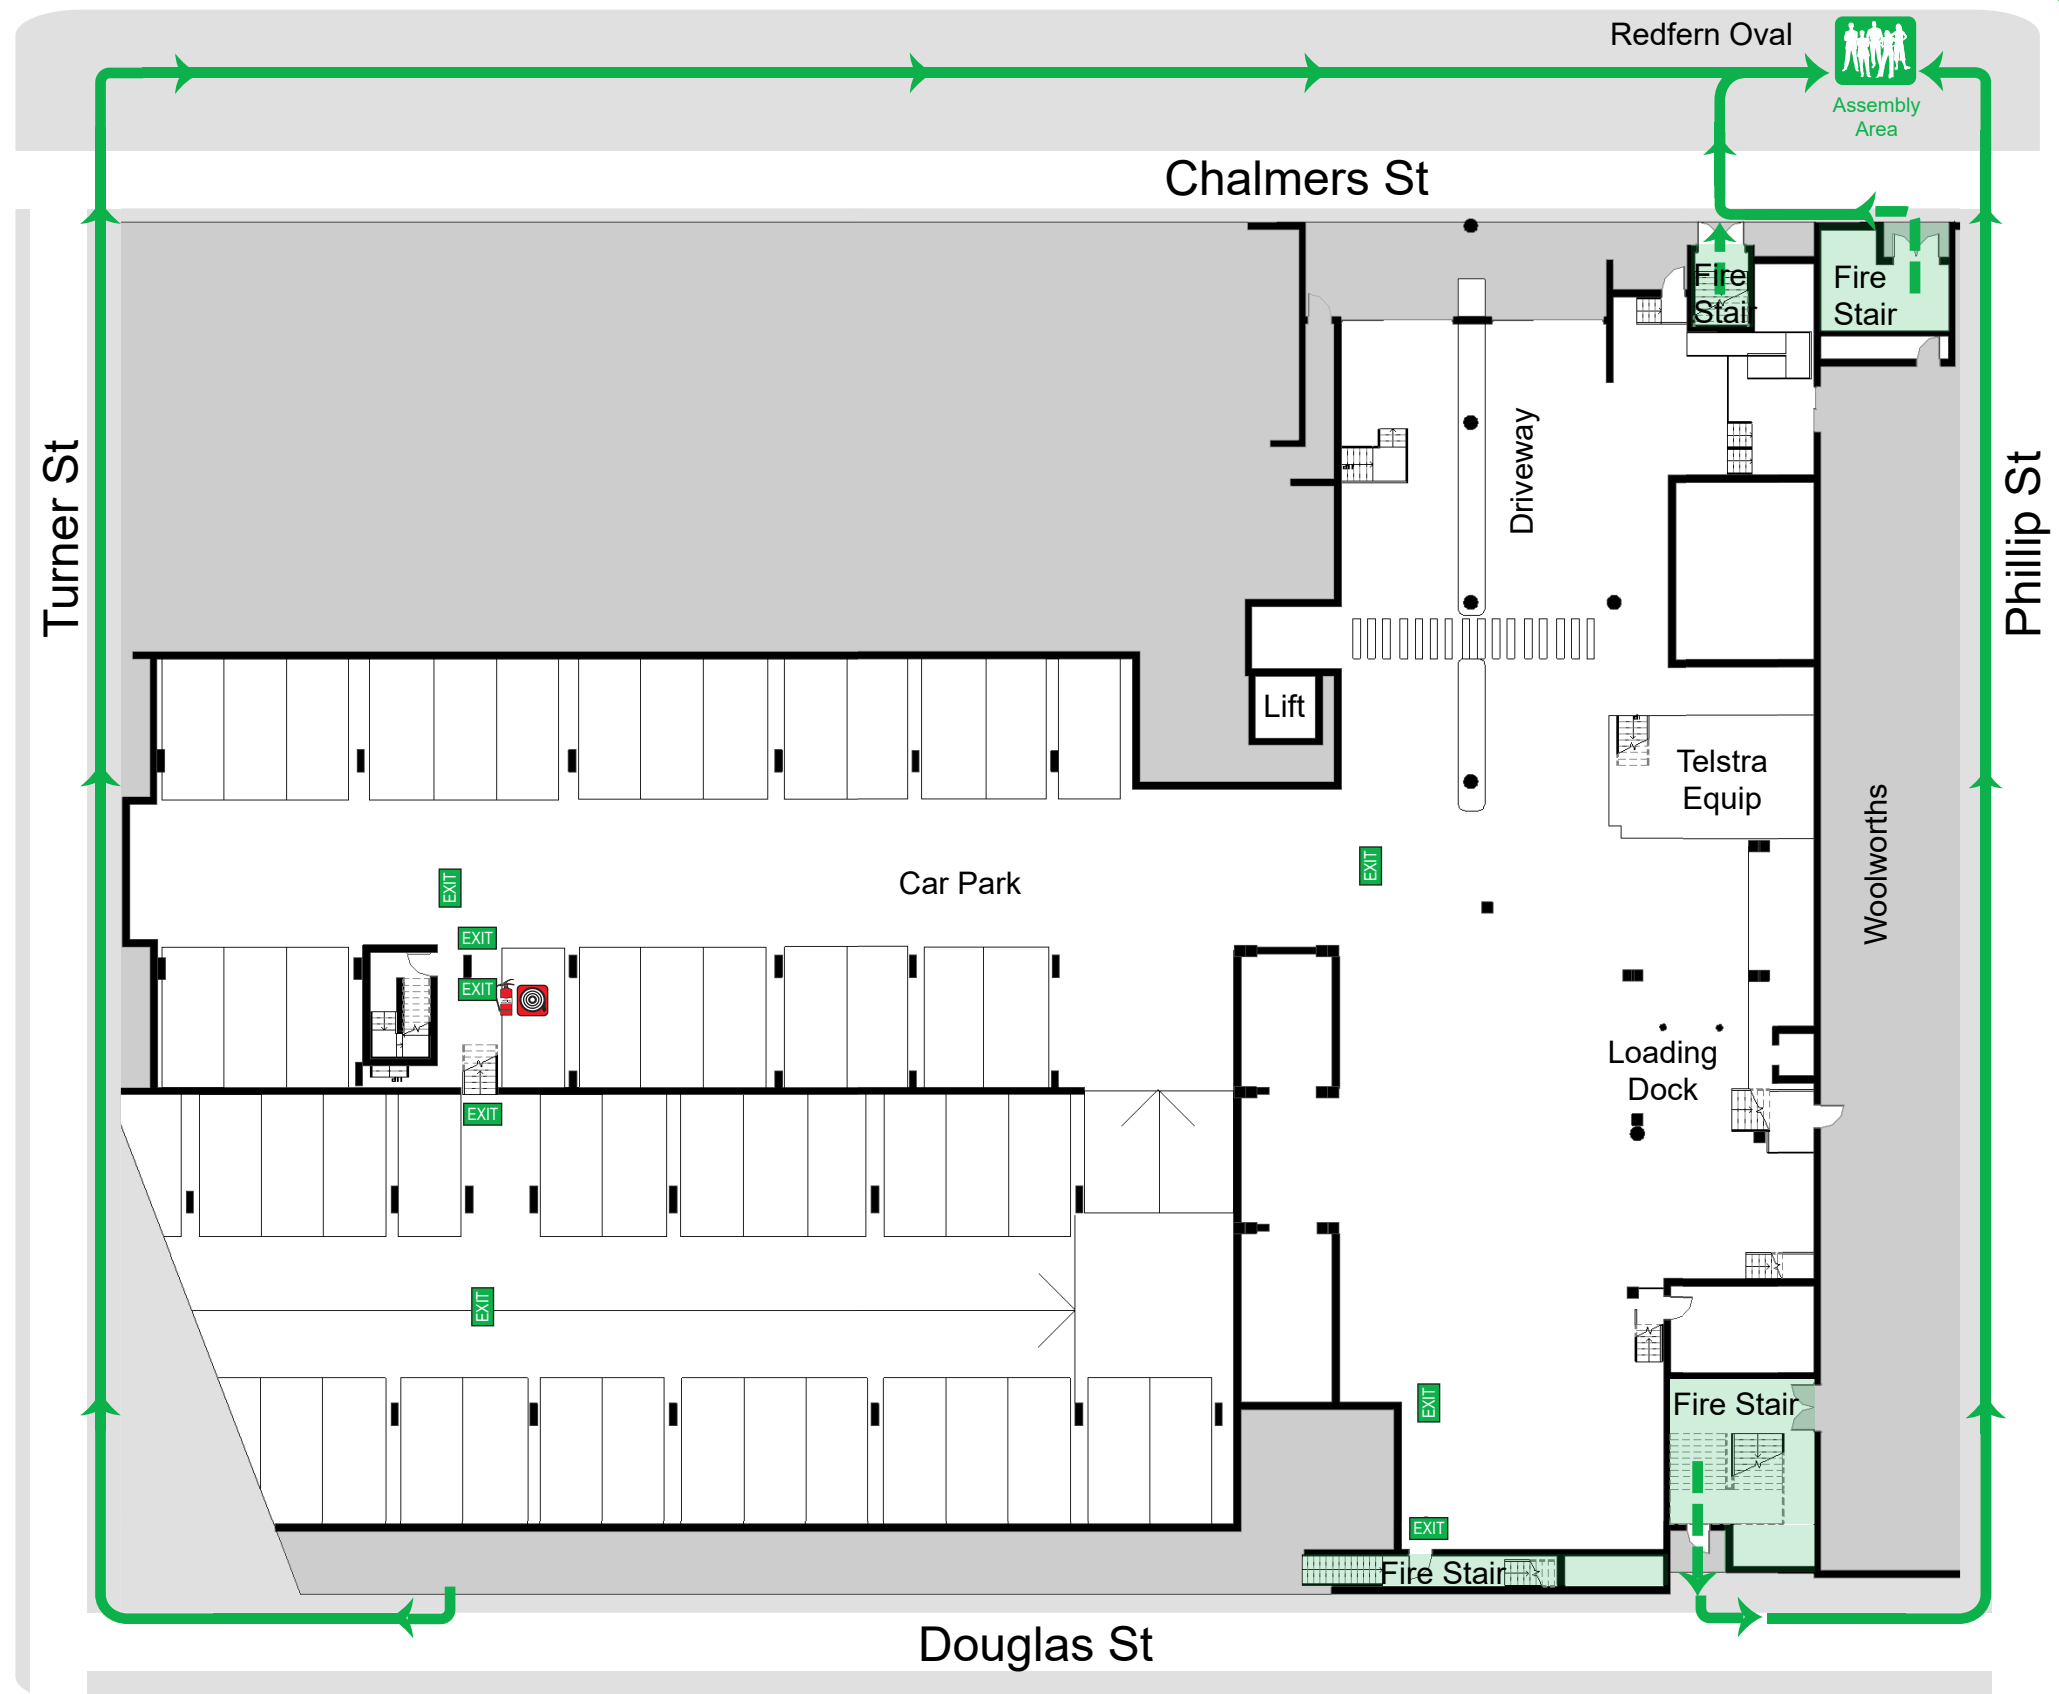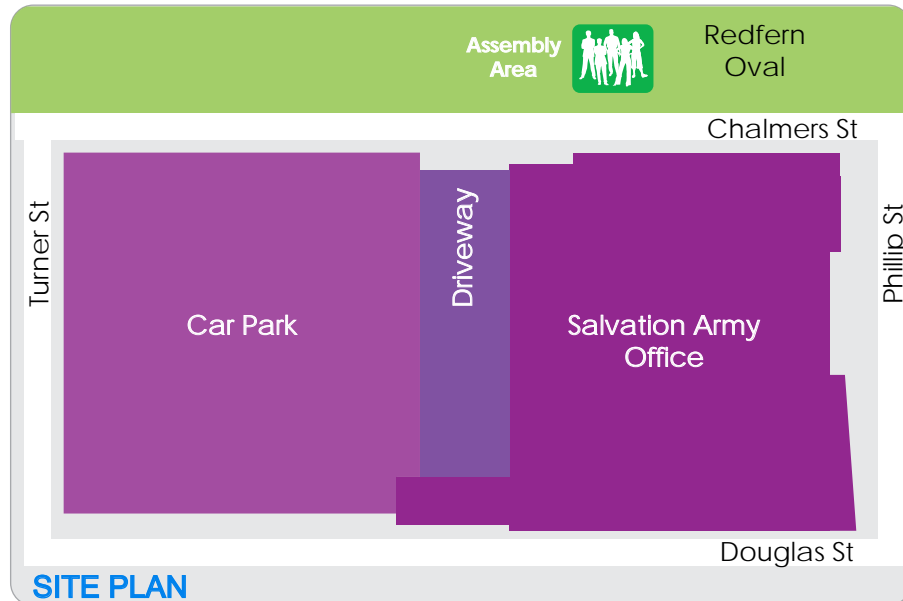

car park - ground floor

not to scale



evacuation diagram

version 1

LEGEND

-  path to exit
-  path to assembly area
-  assembly area
WARNING Keep a minimum 30m clear of the building
-  illuminated exit sign
-  required illuminated exit sign
-  fire extinguisher
-  fire blanket
-  fire hose reel
-  fire indicator panel / main emergency control panel
-  fire hydrant
-  first aid
-  break glass alarm



EMERGENCY

R REMOVE OCCUPANTS FROM IMMEDIATE DANGER AREA
Safety to self, scene and survivors in that order

A ALERT ALL OCCUPANTS AND RAISE AN ALARM
DIAL 000 - Ask for the Fire Brigade

C CONFINE THE DANGER CLOSE DOORS + WINDOWS
Restrict the spread of fire, attempt to extinguish the fire if trained and safe to do so.

E EVACUATE TO A SAFE AREA AND WAIT FOR ASSISTANCE
Use the nearest safe exit door. Once safe wait for assistance from the responding emergency services.

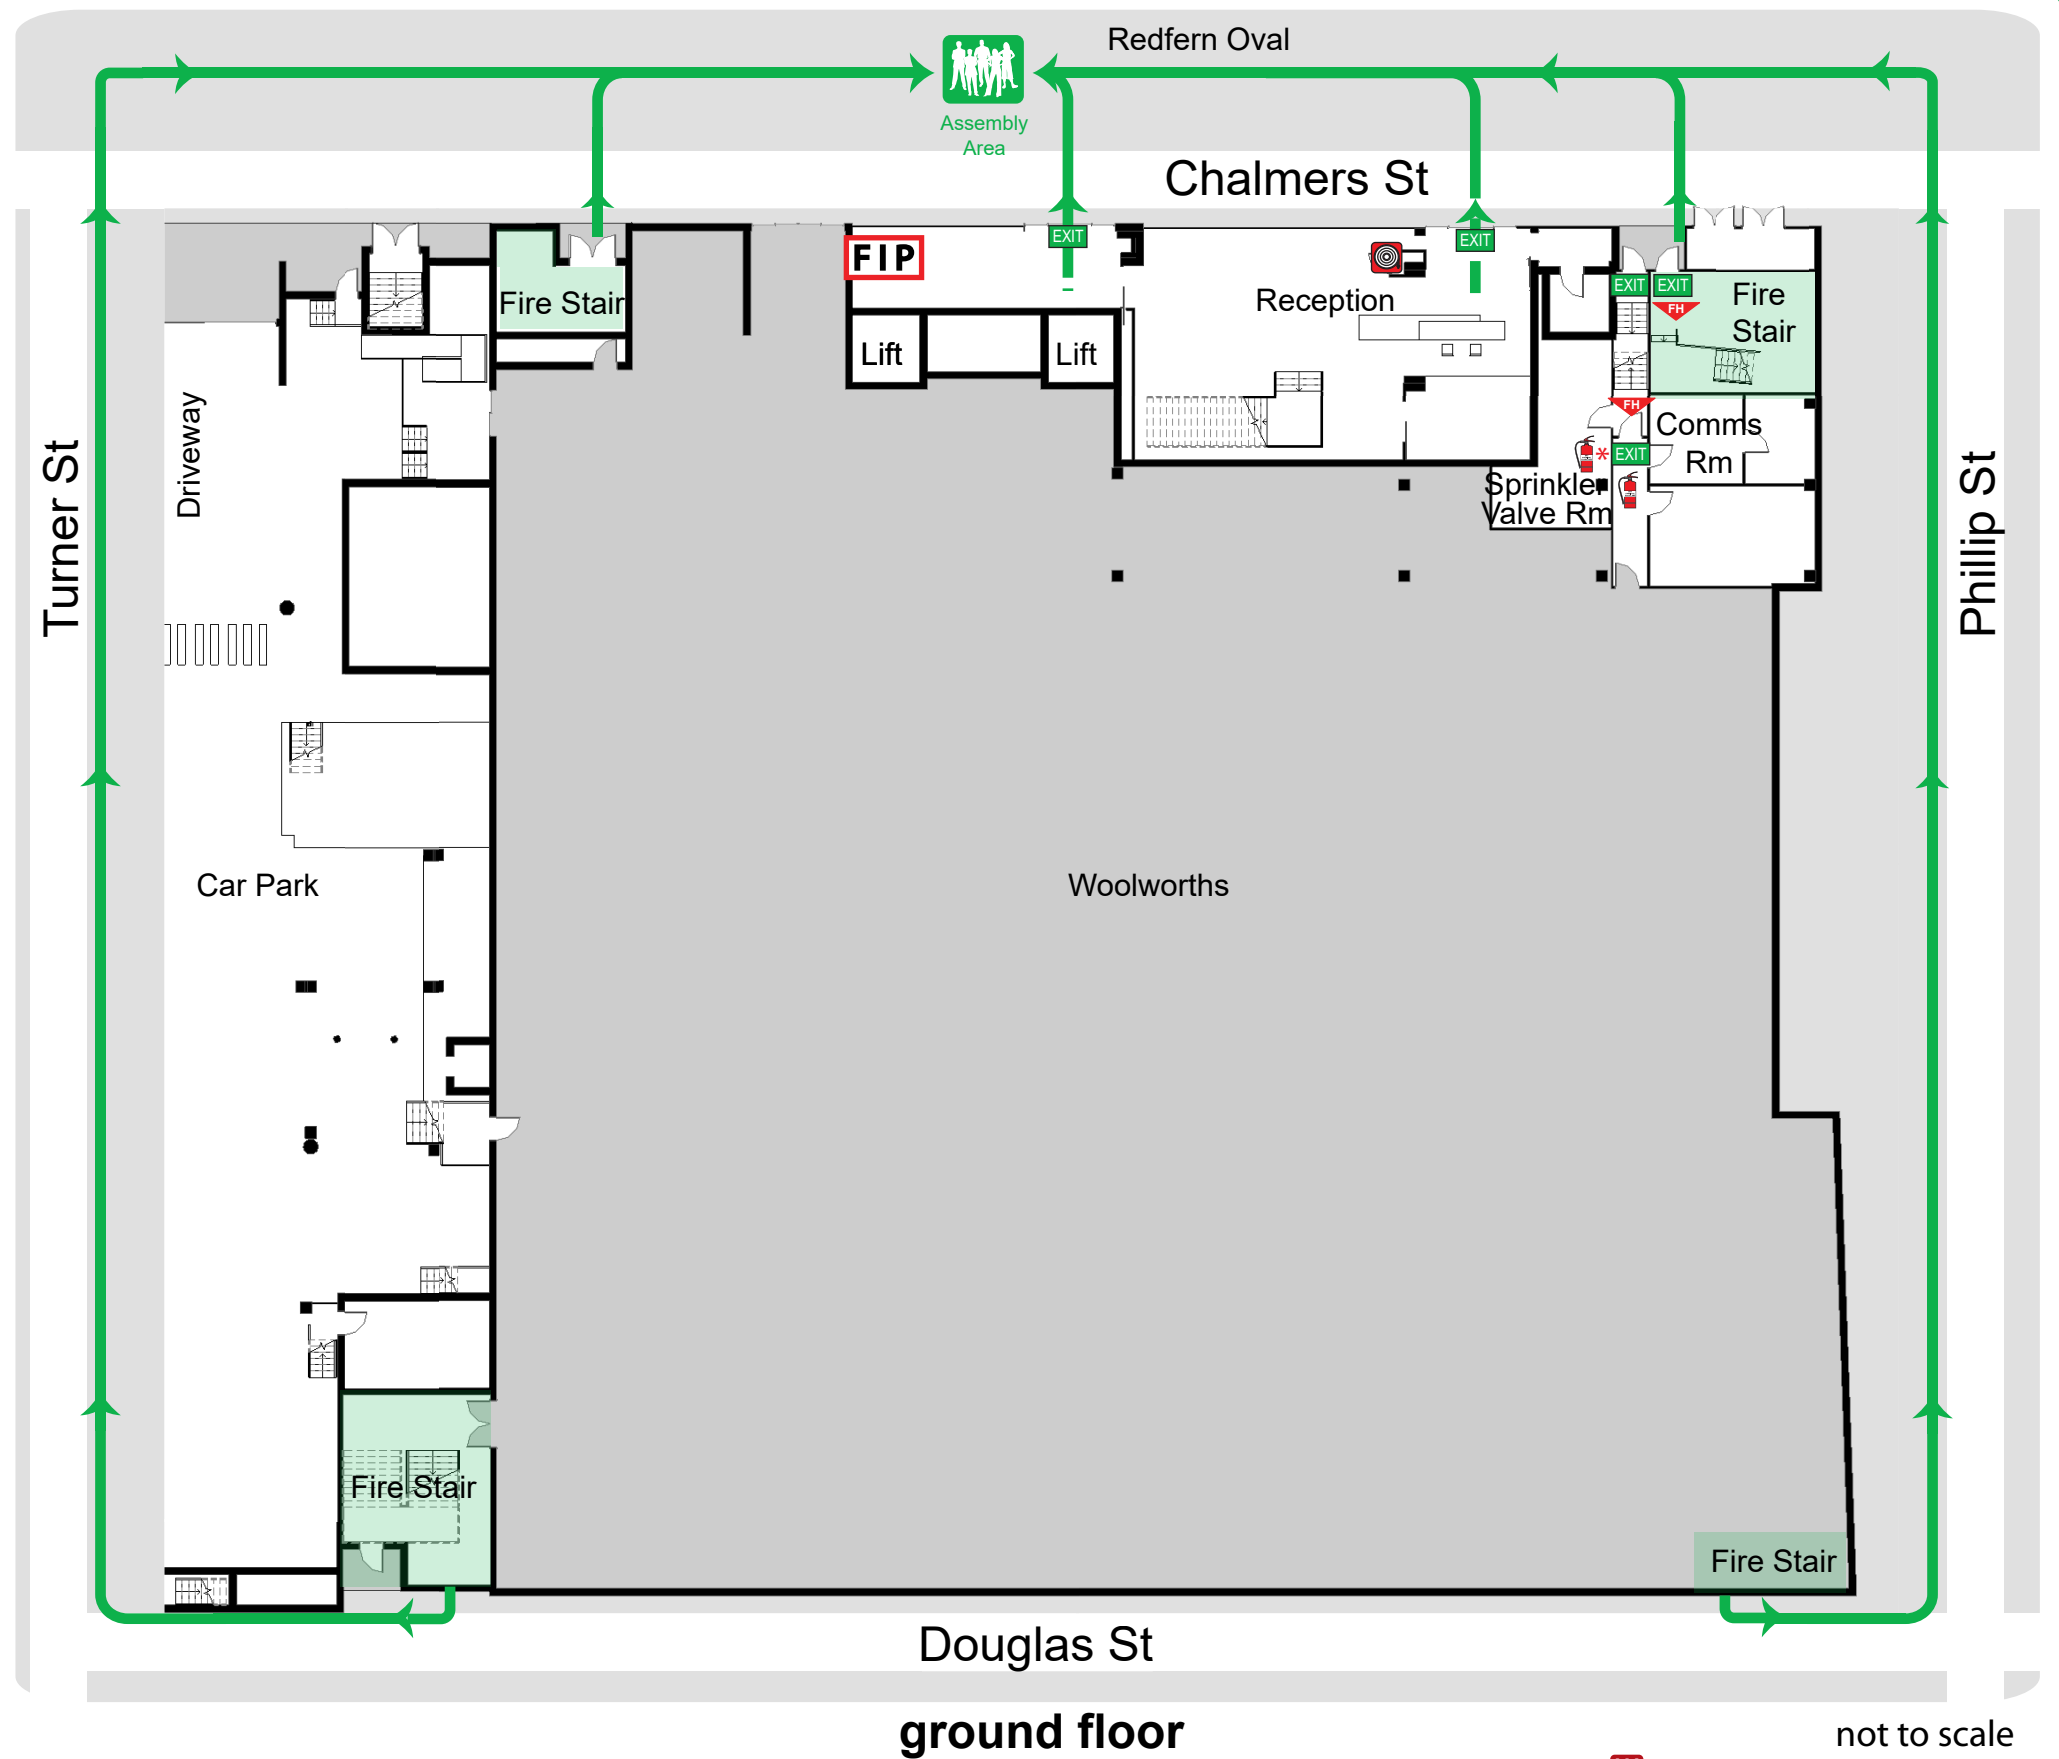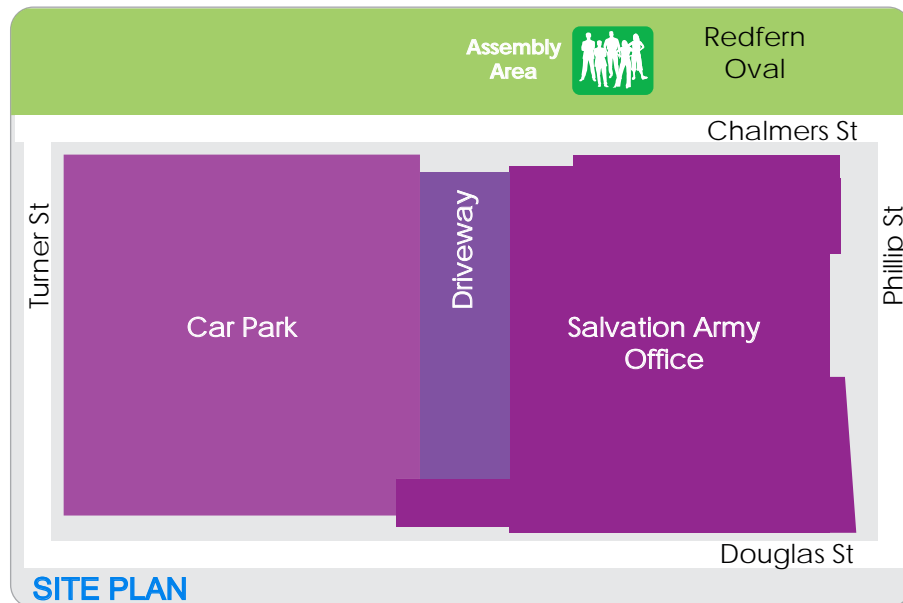

evacuation diagram

version 1

LEGEND

-  path to exit
-  path to assembly area
-  assembly area
WARNING Keep a minimum 30m clear of the building
-  illuminated exit sign
-  required illuminated exit sign
-  fire extinguisher
-  fire blanket
-  fire hose reel
-  fire indicator panel / main emergency control panel
-  fire hydrant
-  first aid
-  break glass alarm



EMERGENCY

R REMOVE OCCUPANTS FROM IMMEDIATE DANGER AREA
Safety to self, scene and survivors in that order

A ALERT ALL OCCUPANTS AND RAISE AN ALARM
DIAL 000 - Ask for the Fire Brigade

C CONFINE THE DANGER CLOSE DOORS + WINDOWS
Restrict the spread of fire, attempt to extinguish the fire if trained and safe to do so.

E EVACUATE TO A SAFE AREA AND WAIT FOR ASSISTANCE
Use the nearest safe exit door. Once safe wait for assistance from the responding emergency services.

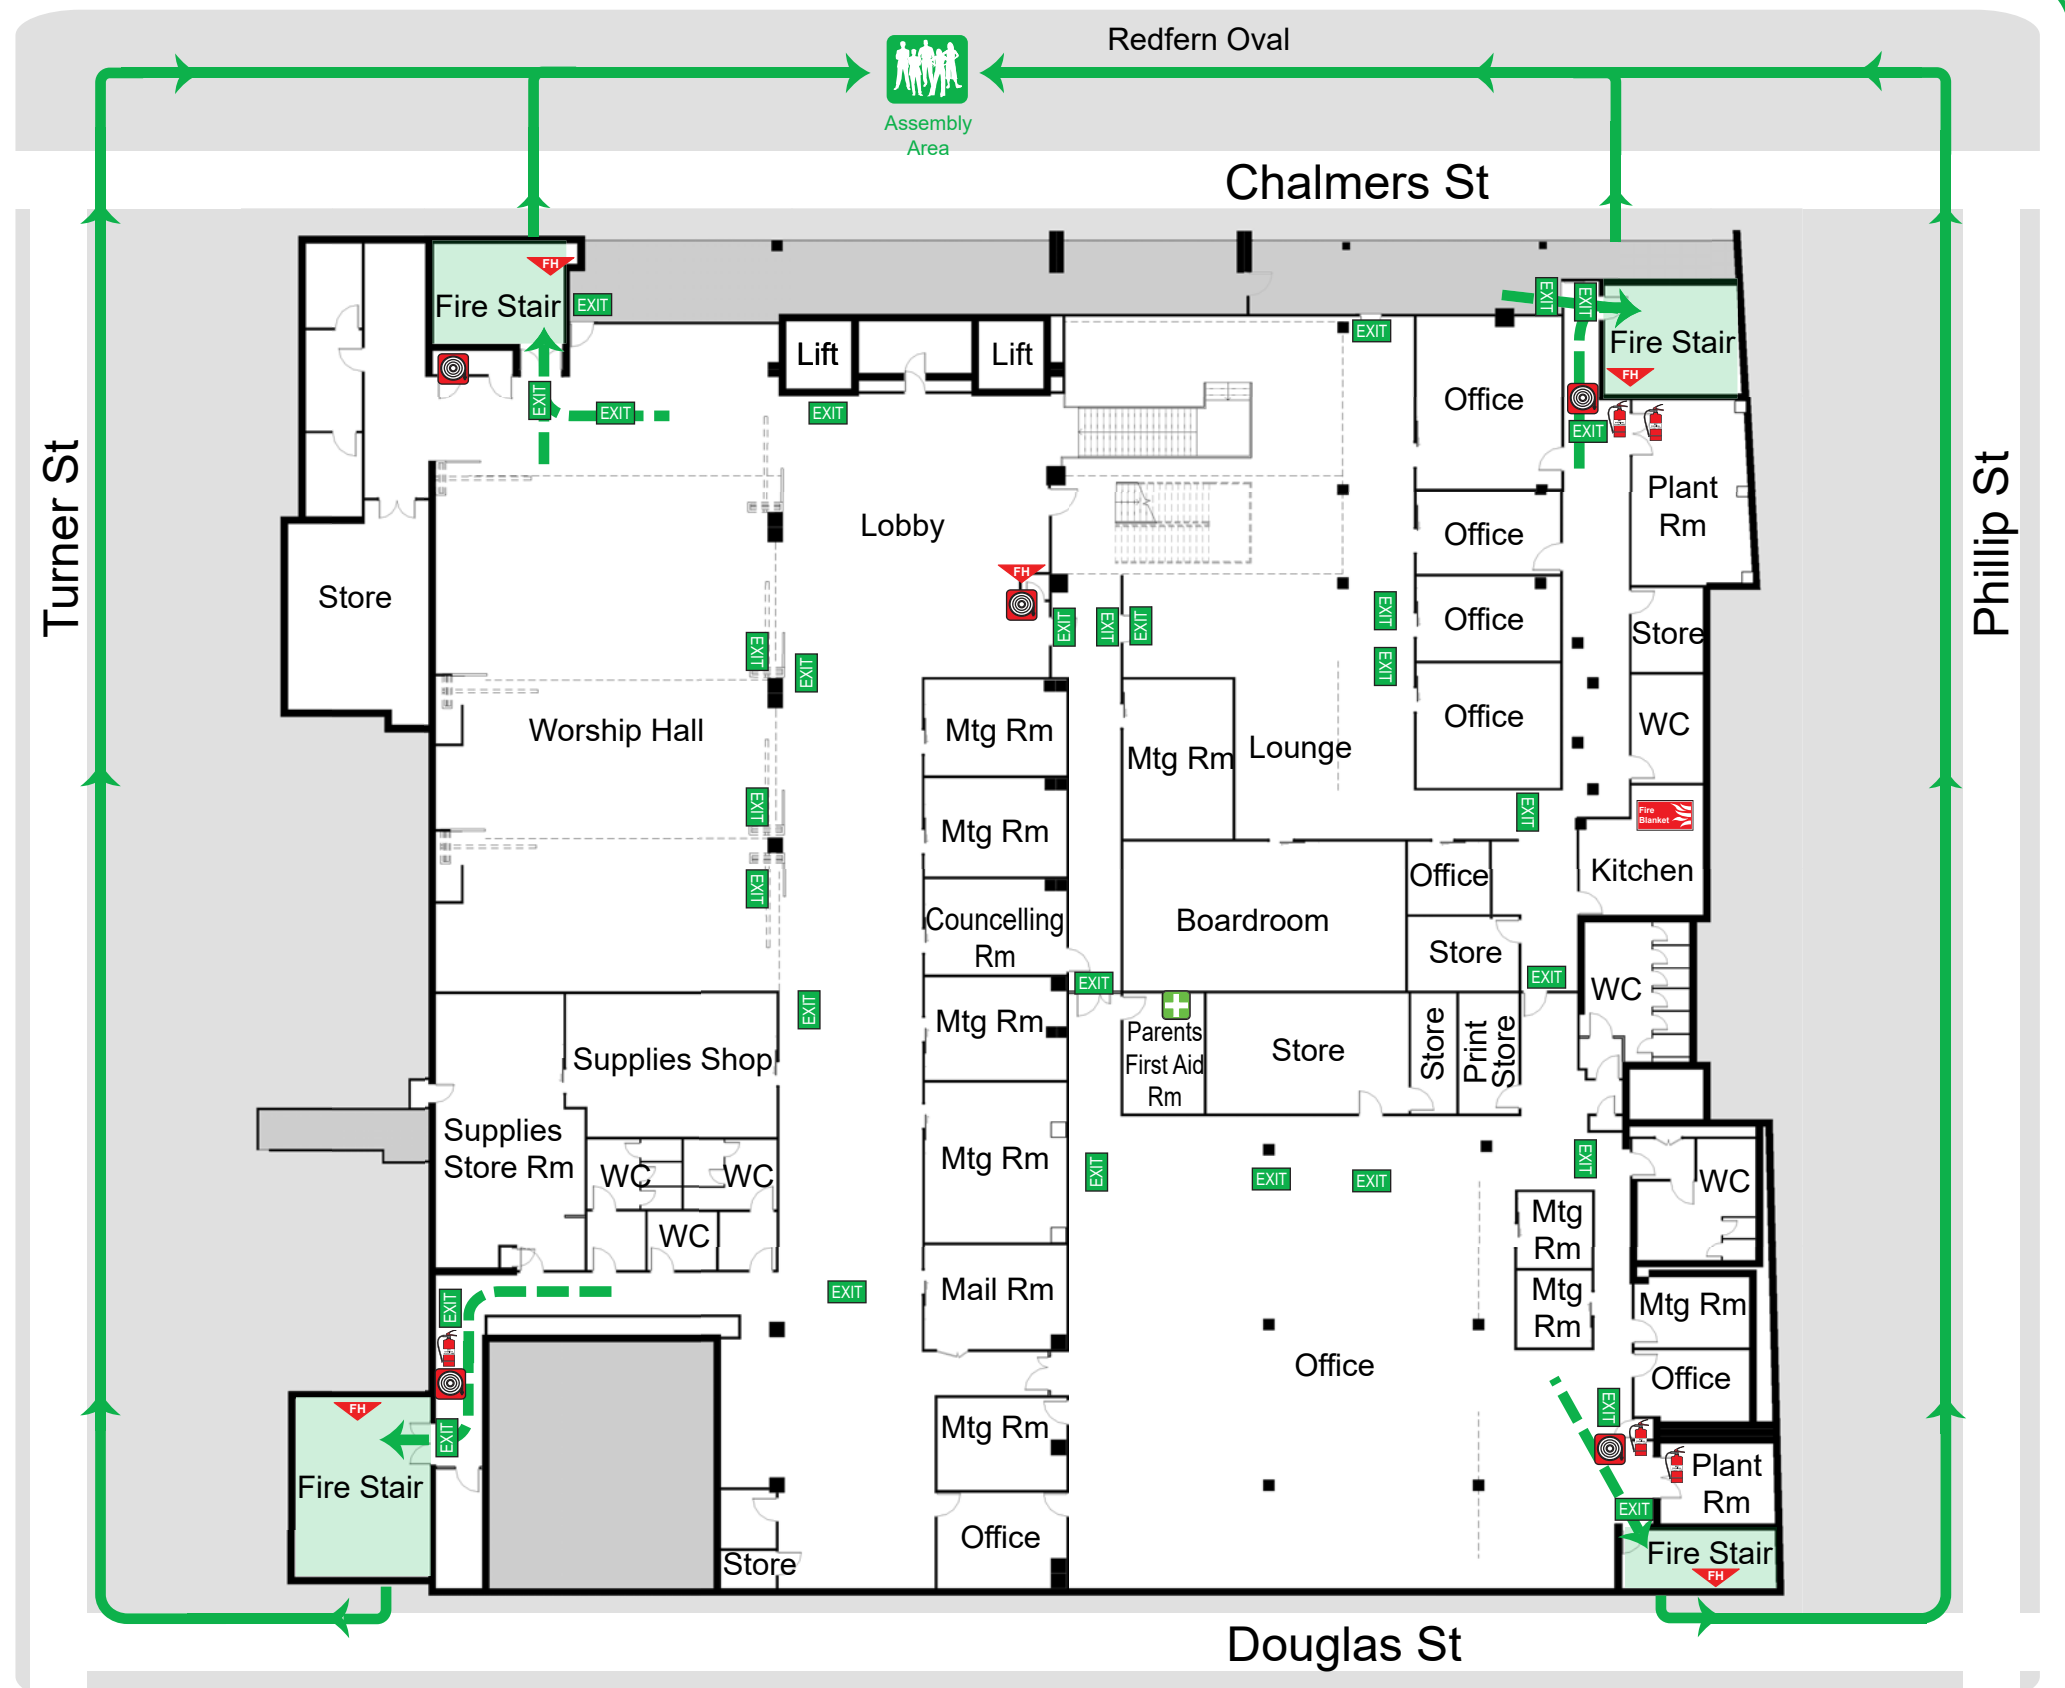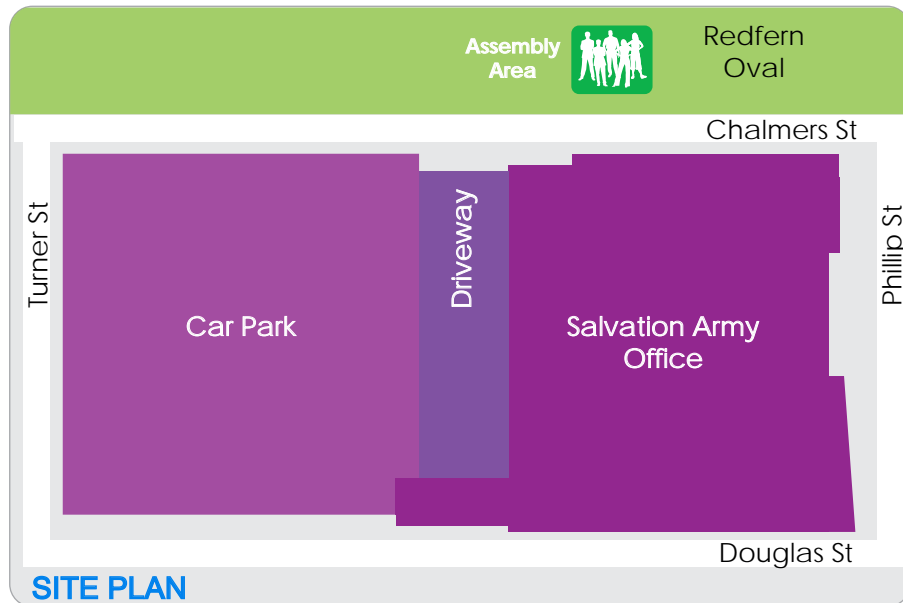

not to scale

tyrrells.com
PLANS & APPROVALS
ph 1300 131 270
© tyrrells.com 2009

evacuation diagram

version 1

LEGEND

-  path to exit
-  path to assembly area
-  assembly area
WARNING Keep a minimum 30m clear of the building
-  illuminated exit sign
-  required illuminated exit sign
-  fire extinguisher
-  fire blanket
-  fire hose reel
-  fire indicator panel / main emergency control panel
-  fire hydrant
-  first aid
-  break glass alarm



EMERGENCY

R REMOVE OCCUPANTS FROM IMMEDIATE DANGER AREA
Safety to self, scene and survivors in that order

A ALERT ALL OCCUPANTS AND RAISE AN ALARM
DIAL 000 - Ask for the Fire Brigade

C CONFINE THE DANGER CLOSE DOORS + WINDOWS
Restrict the spread of fire, attempt to extinguish the fire if trained and safe to do so.

E EVACUATE TO A SAFE AREA AND WAIT FOR ASSISTANCE
Use the nearest safe exit door. Once safe wait for assistance from the responding emergency services.

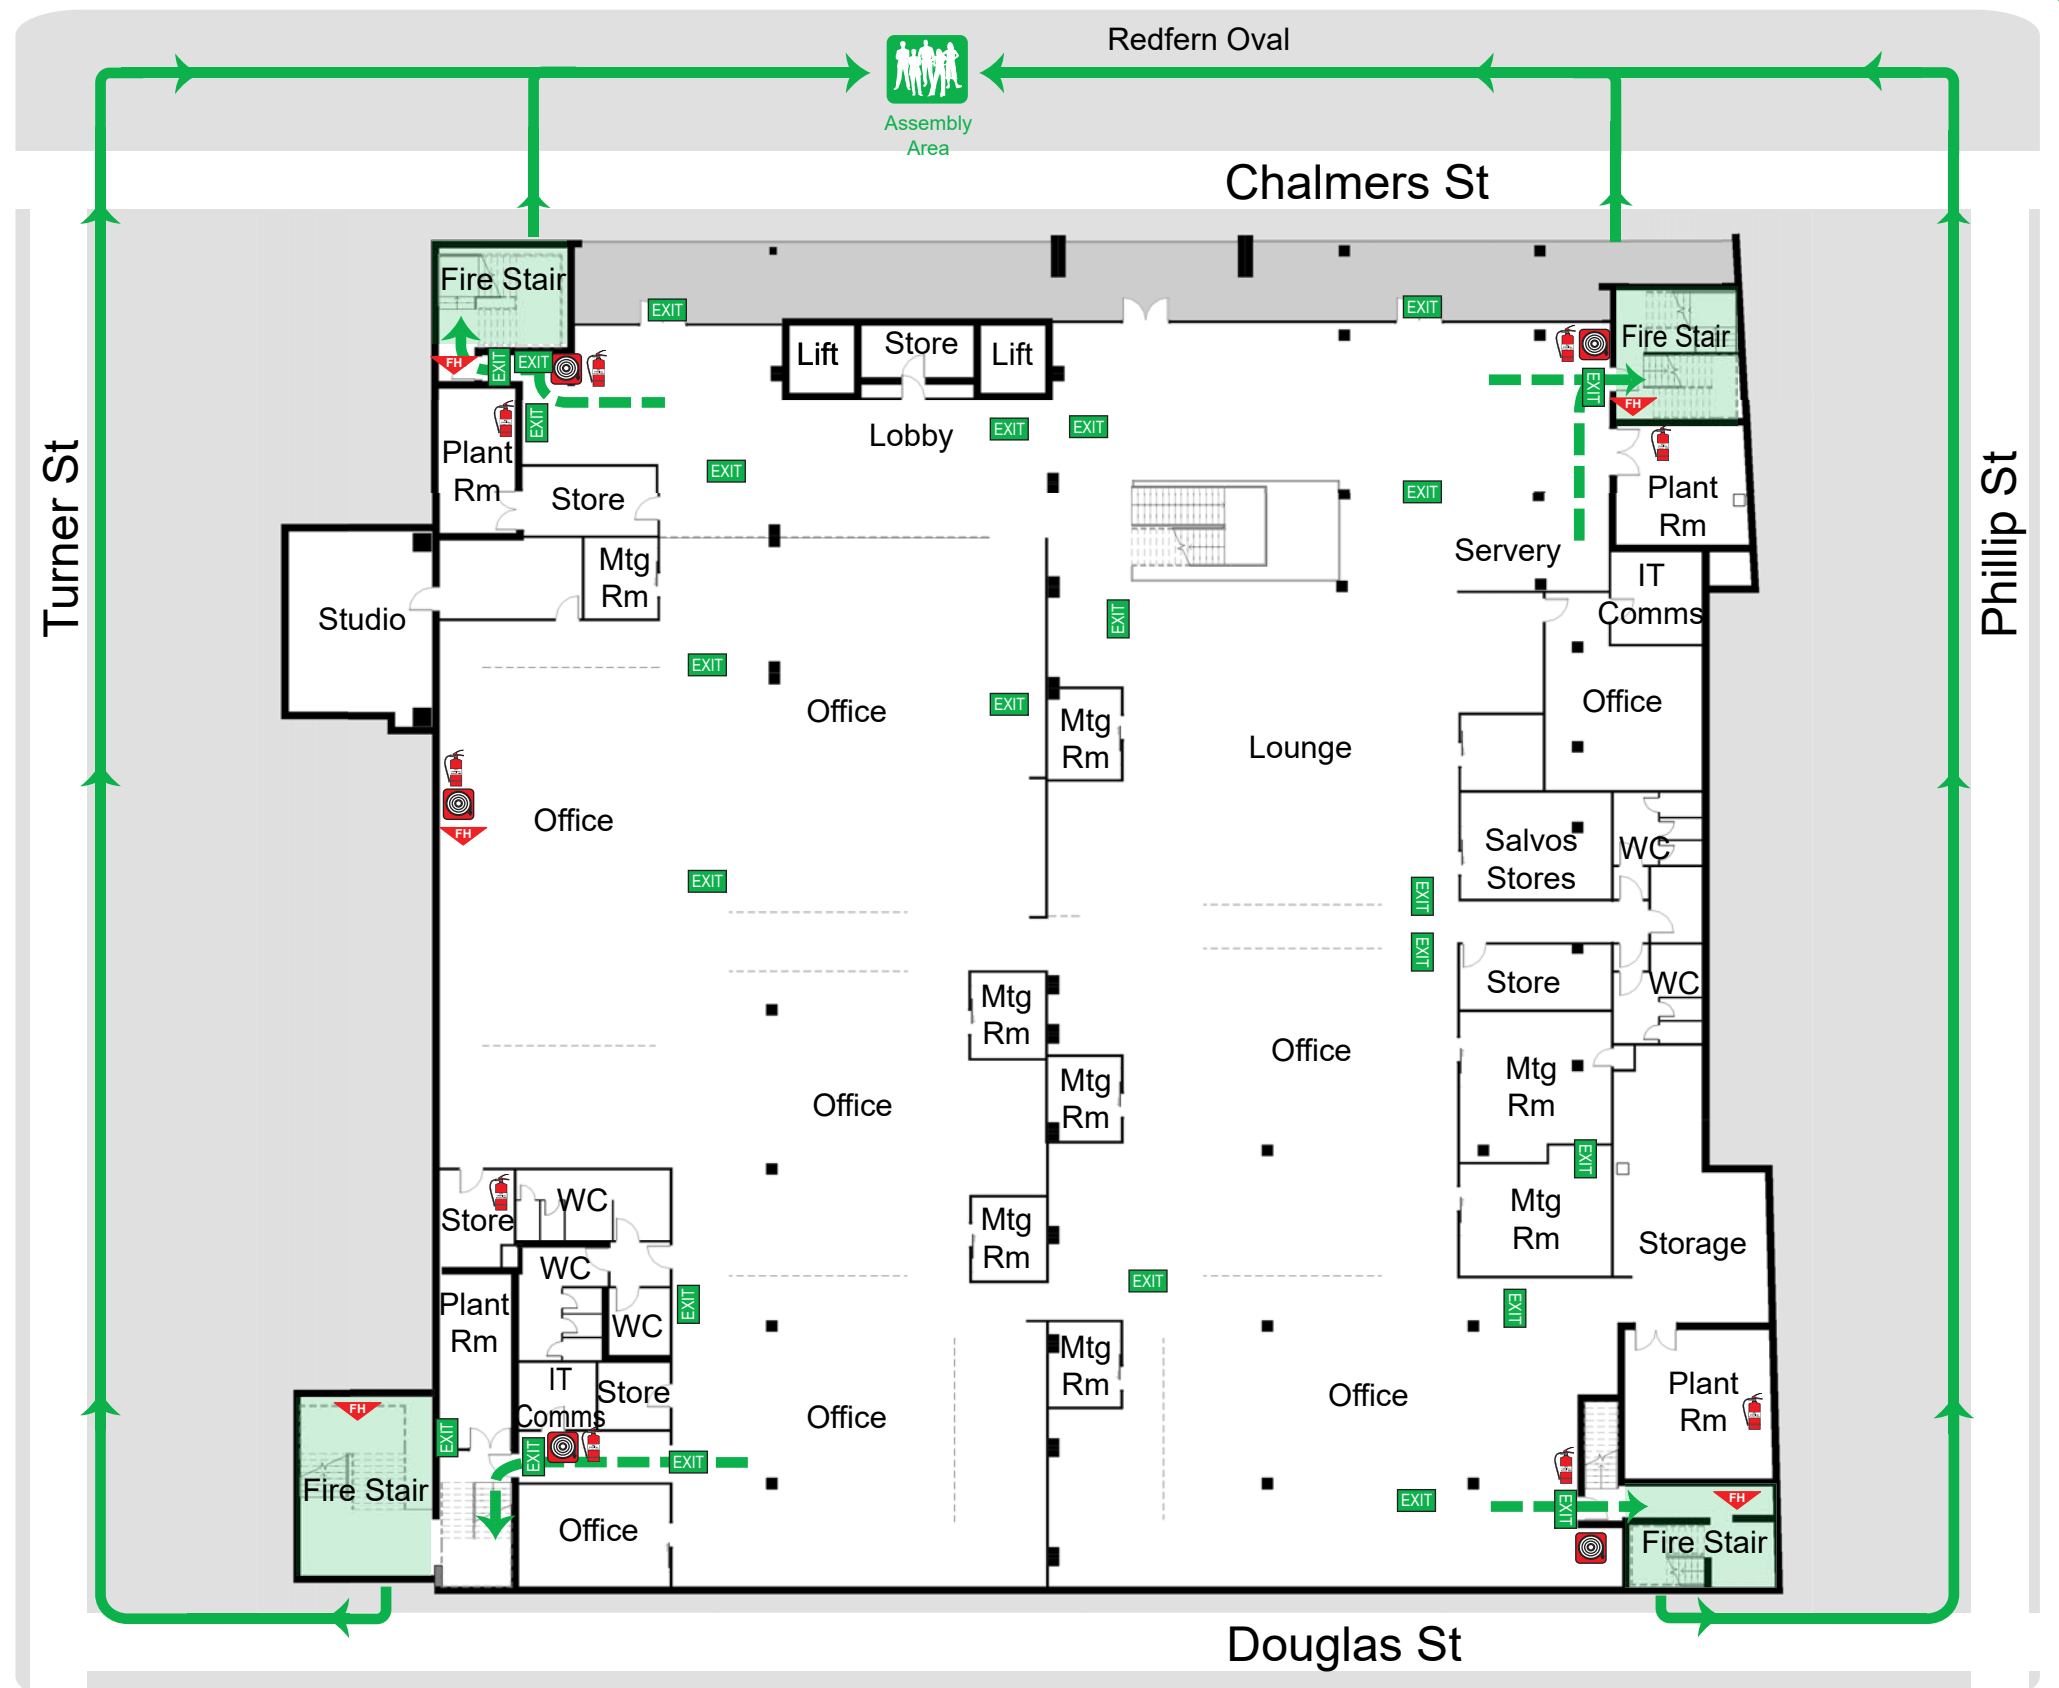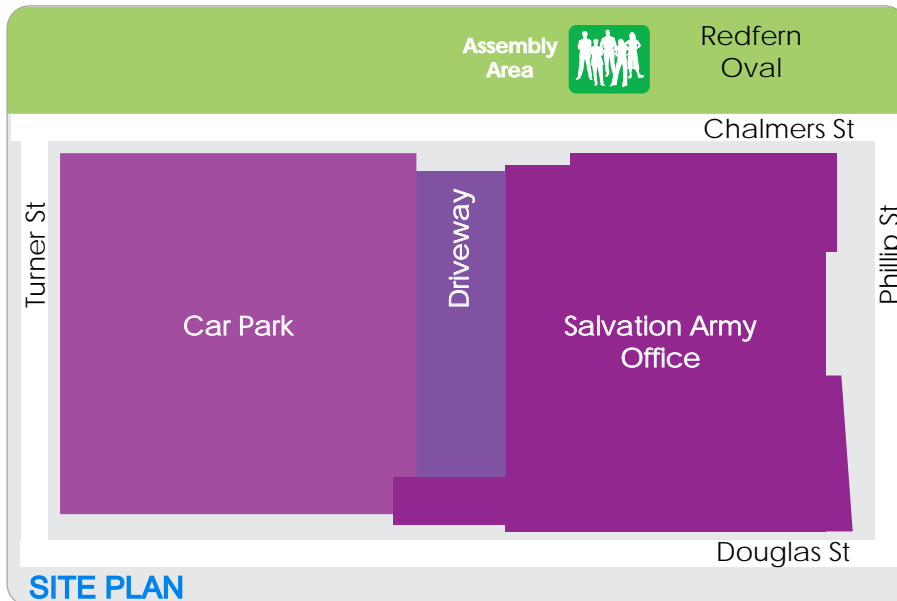

not to scale

 PLANS & APPROVALS
 ph 1300 131 270
 © tyrrells.com 2009

evacuation diagram

version 1

LEGEND

-  path to exit
-  path to assembly area
-  assembly area
WARNING Keep a minimum 30m clear of the building
-  illuminated exit sign
-  required illuminated exit sign
-  fire extinguisher
-  fire blanket
-  fire hose reel
-  fire indicator panel / main emergency control panel
-  fire hydrant
-  first aid
-  break glass alarm



EMERGENCY

R REMOVE OCCUPANTS FROM IMMEDIATE DANGER AREA
Safety to self, scene and survivors in that order

A ALERT ALL OCCUPANTS AND RAISE AN ALARM
DIAL 000 - Ask for the Fire Brigade

C CONFINE THE DANGER CLOSE DOORS + WINDOWS
Restrict the spread of fire, attempt to extinguish the fire if trained and safe to do so.

E EVACUATE TO A SAFE AREA AND WAIT FOR ASSISTANCE
Use the nearest safe exit door. Once safe wait for assistance from the responding emergency services.

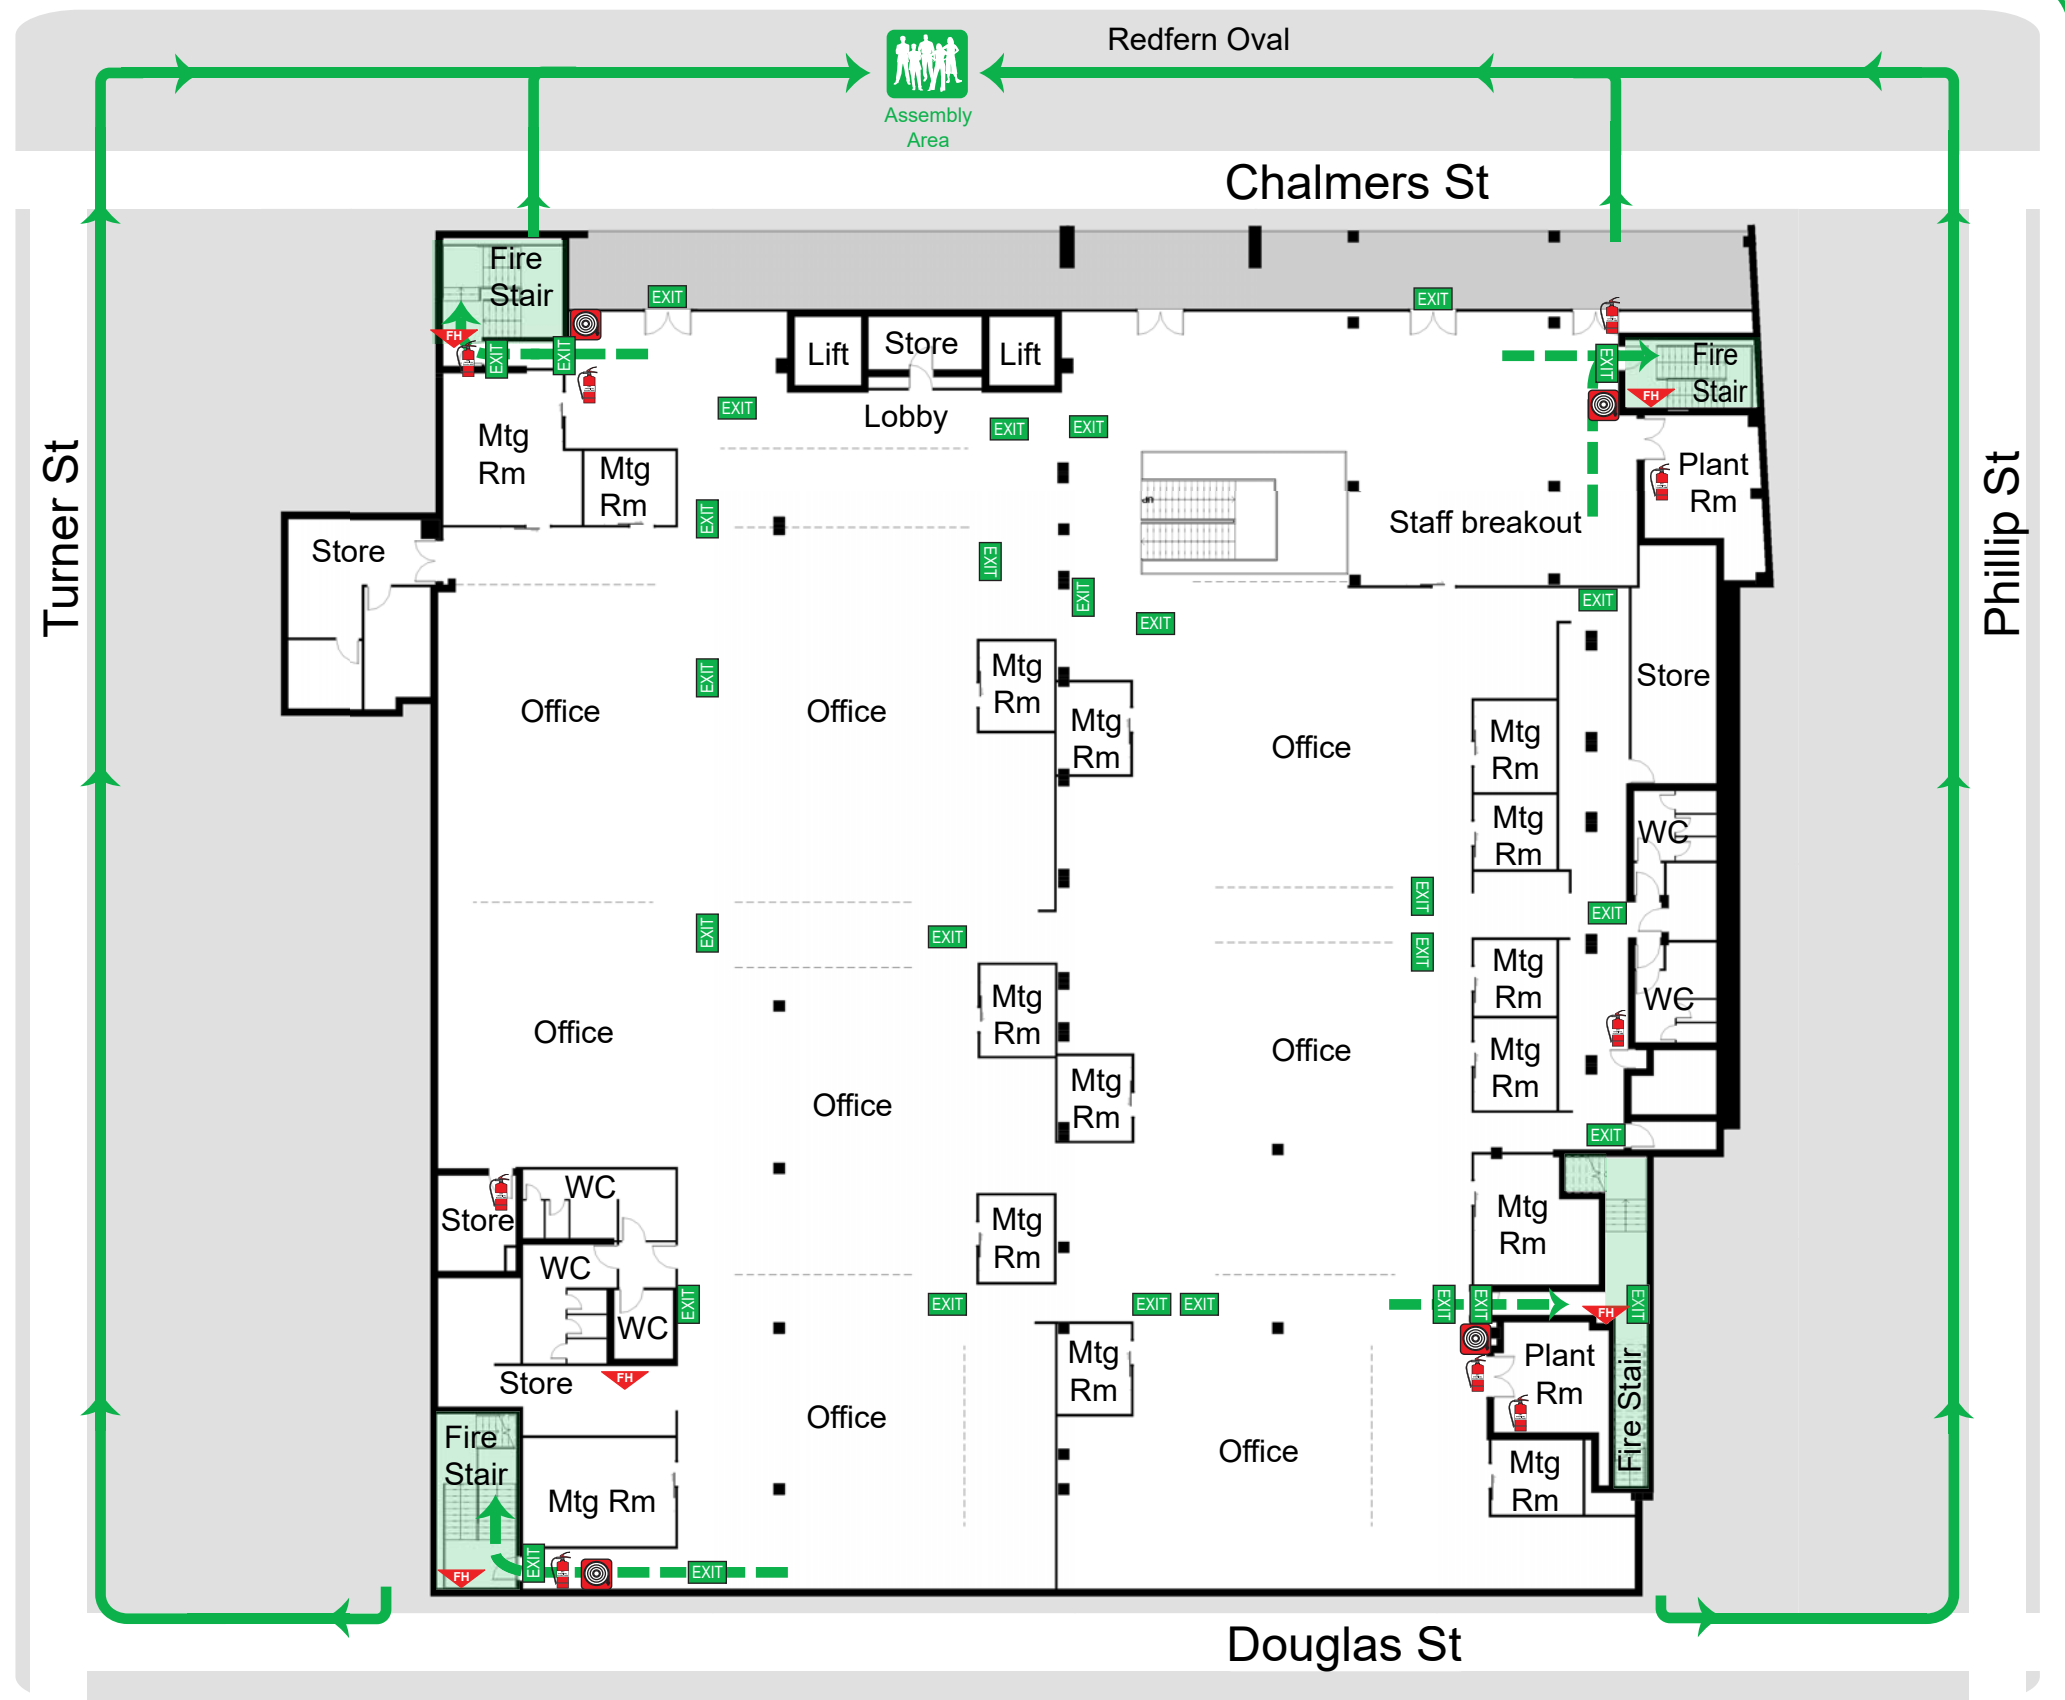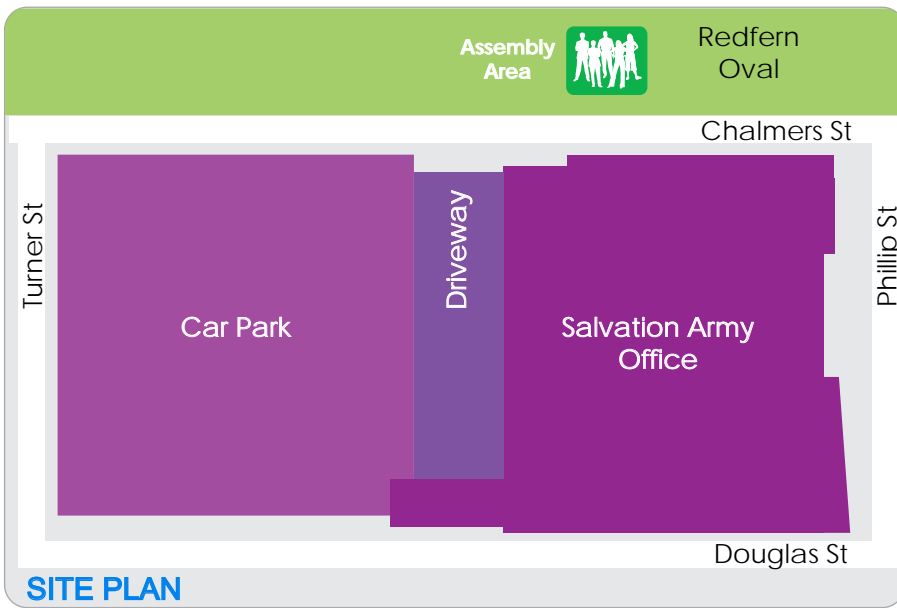

level 3

not to scale

tyrrells.com
PLANS & APPROVALS
ph 1300 131 270
© tyrrells.com 2009

evacuation diagram

version 1

LEGEND

-  path to exit
-  path to assembly area
-  assembly area
WARNING Keep a minimum 30m clear of the building
-  illuminated exit sign
-  required illuminated exit sign
-  fire extinguisher
-  fire blanket
-  fire hose reel
-  fire indicator panel / main emergency control panel
-  fire hydrant
-  first aid
-  break glass alarm



EMERGENCY

R REMOVE OCCUPANTS FROM IMMEDIATE DANGER AREA
Safety to self, scene and survivors in that order

A ALERT ALL OCCUPANTS AND RAISE AN ALARM
DIAL 000 - Ask for the Fire Brigade

C CONFINE THE DANGER CLOSE DOORS + WINDOWS
Restrict the spread of fire, attempt to extinguish the fire if trained and safe to do so.

E EVACUATE TO A SAFE AREA AND WAIT FOR ASSISTANCE
Use the nearest safe exit door. Once safe wait for assistance from the responding emergency services.

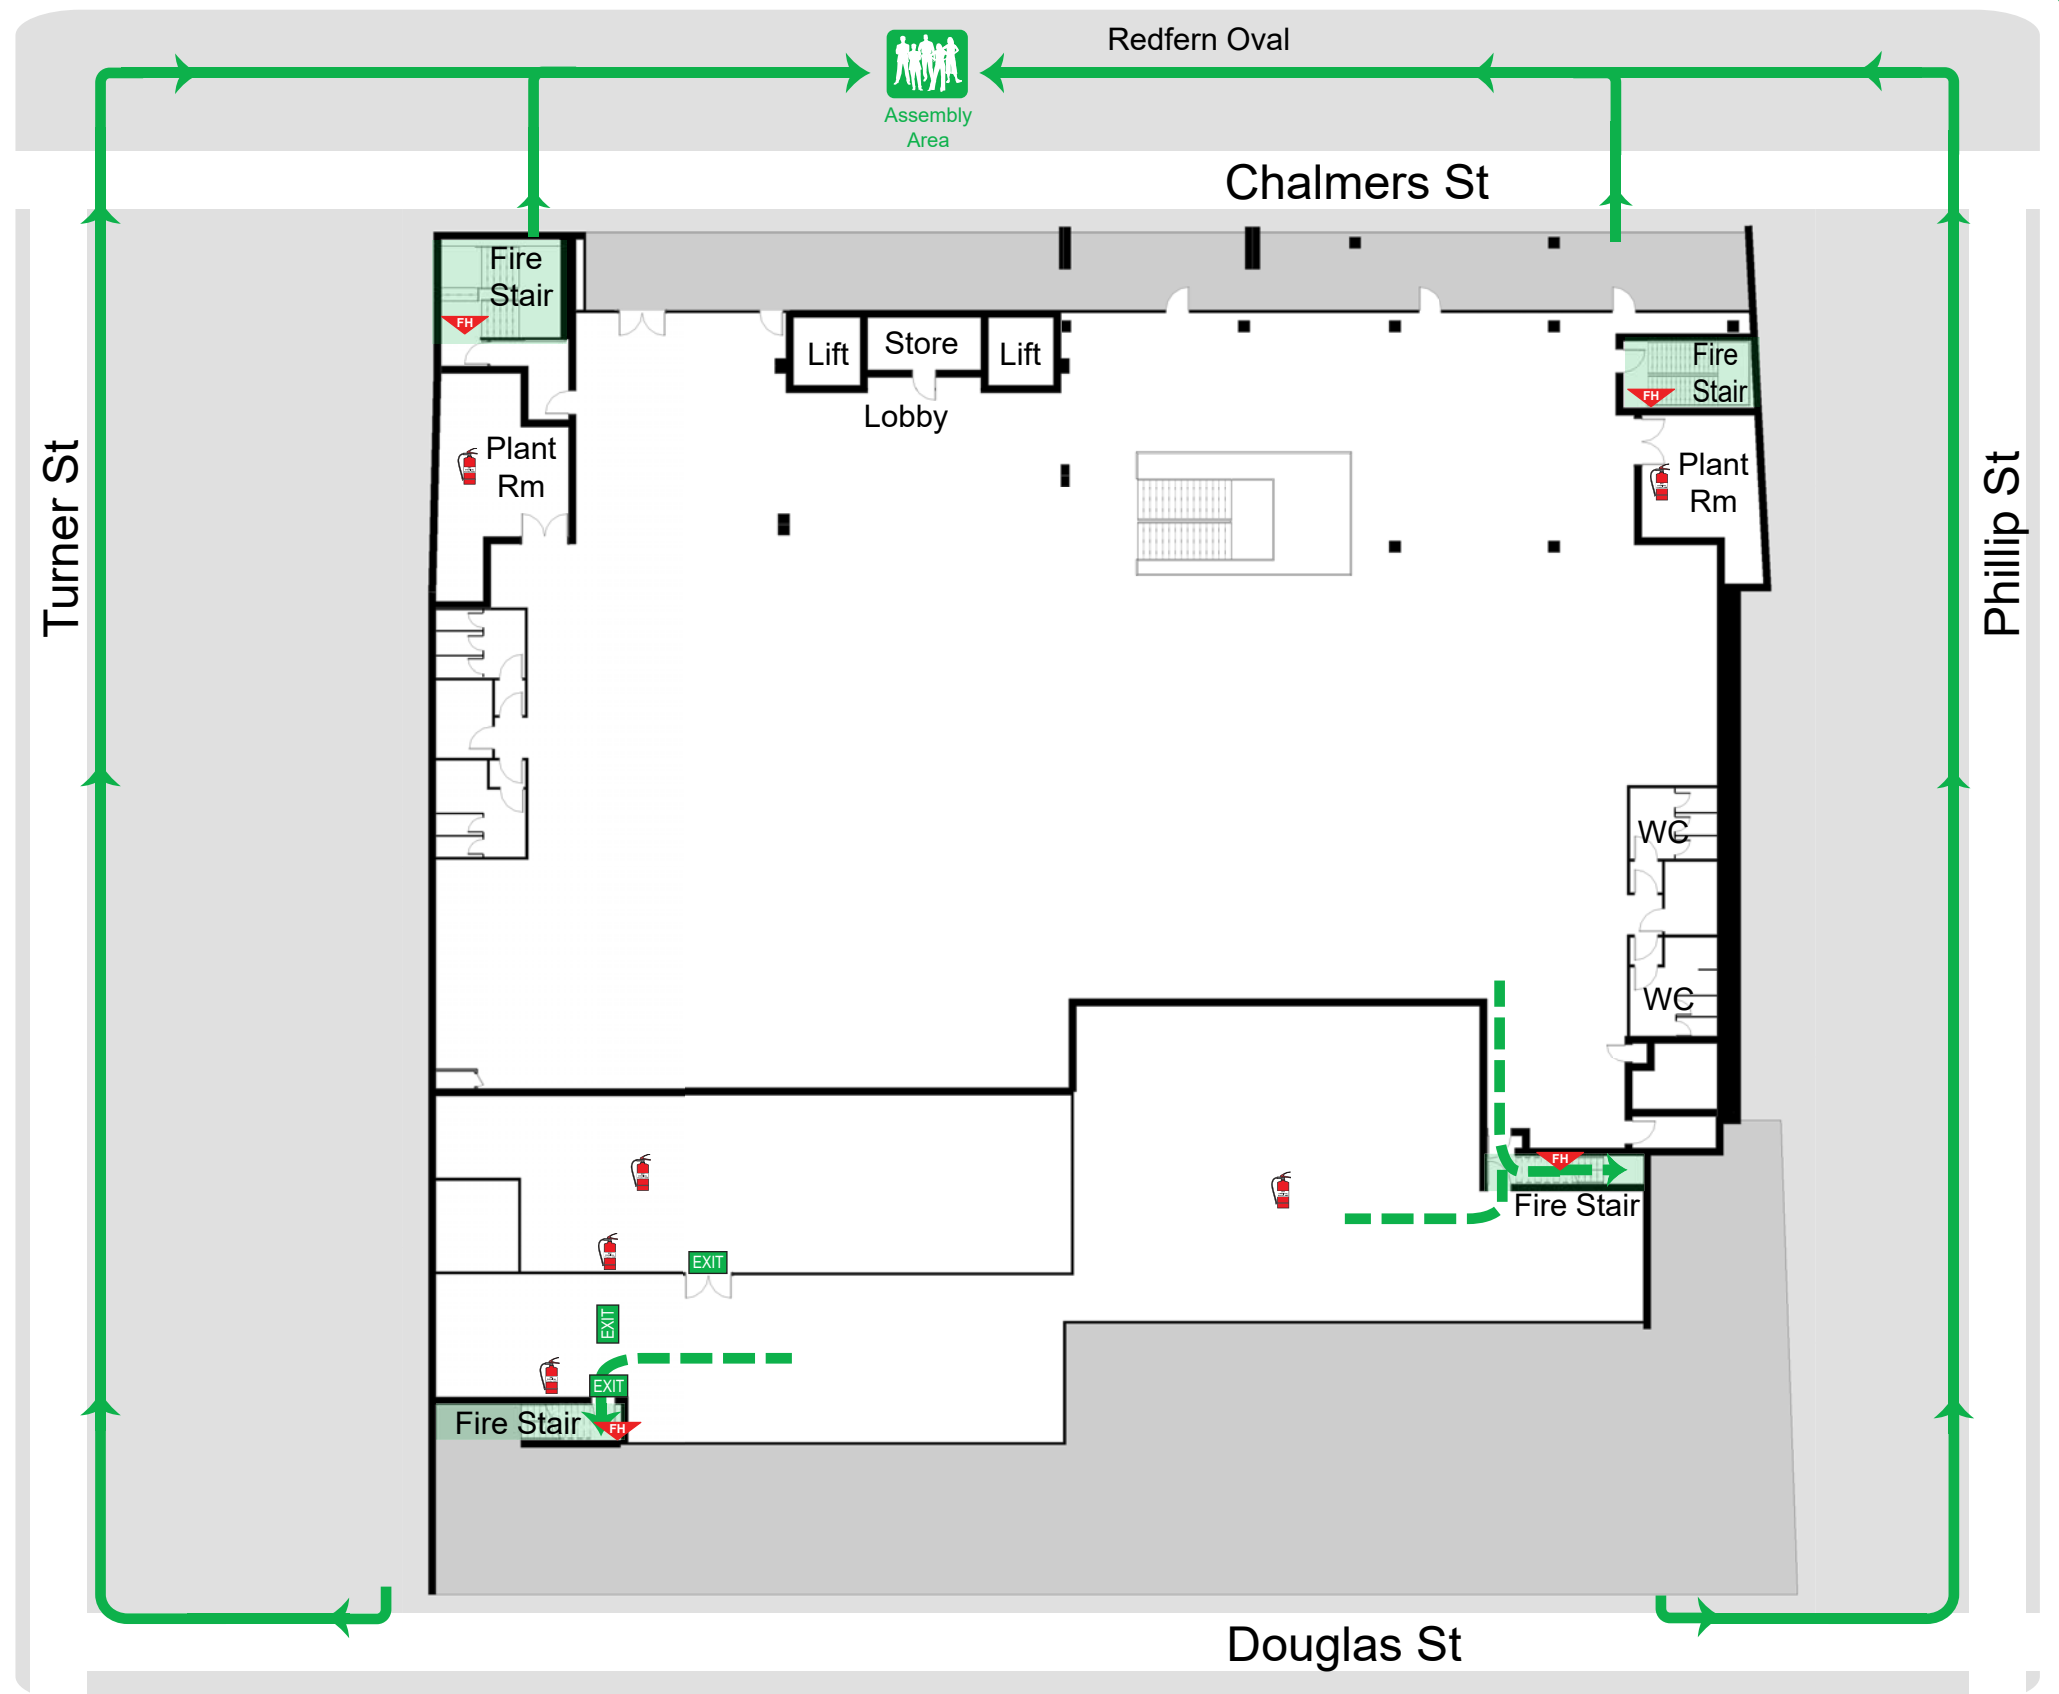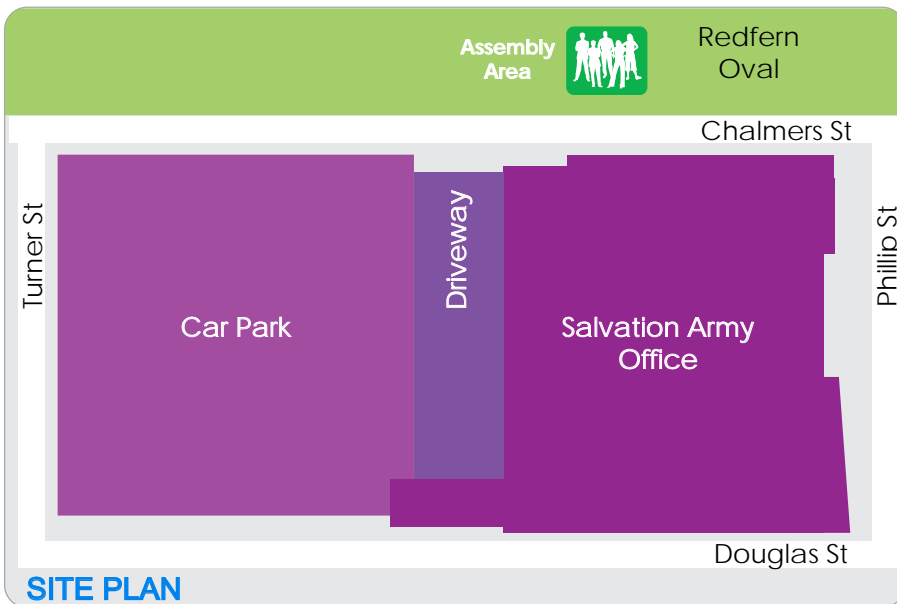

level 4

not to scale

